


**2020 - 2023 Wastewater Flows in the Sewer Collection Systems
Tributary to the Binghamton-Johnson City Joint Sewage Treatment Facilities
(by Component)**

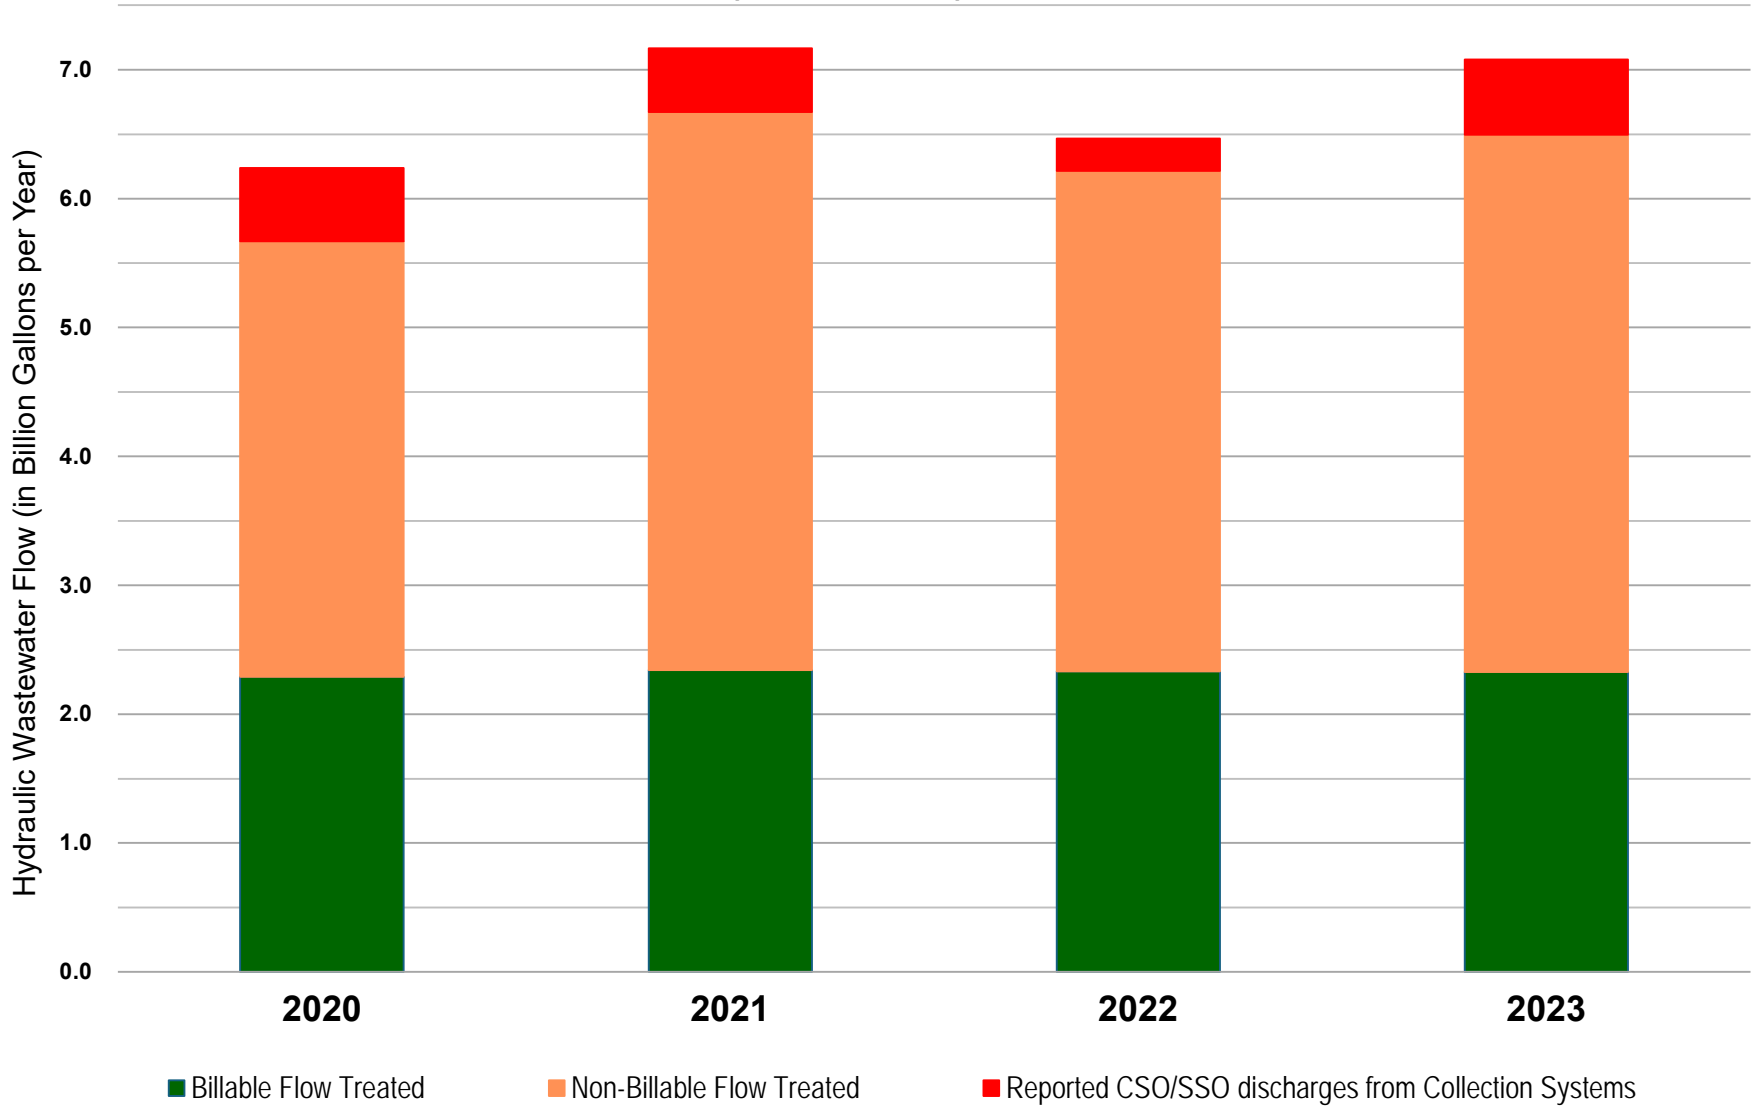

2020 - 2023 Wastewater Flows in Sewer Collection Systems Tributary to the Binghamton-Johnson City Joint Sewage Treatment Facilities (by Component)

Component	(Gallons per Year)			
	2020	2021	2022	2023
Billable Flow Treated	2,290,163,051	2,342,457,741	2,333,332,475	2,328,426,268
Non-Billable Flow Treated	3,379,706,949	4,330,122,259	3,880,897,525	4,167,833,732
SUBTOTAL (Treated Flow)	5,669,870,000	6,672,580,000	6,214,230,000	6,496,260,000
Reported CSO/SSO discharges from Collection Systems	568,863,512	493,908,961	251,028,800	583,360,623
TOTAL SEWER COLLECTION SYSTEM FLOW	6,238,733,512	7,166,488,961	6,465,258,800	7,079,620,623
CSO/SSO Discharges Percentage of <u>Total</u> Sewer Collection System Flow	9.12%	6.89%	3.88%	8.24%